


Air density ( $\gamma$ ): 1.20 kg/m<sup>3</sup>  
 Installation type "A": free inlet, free outlet  
 12000 m<sup>3</sup>/h fan test chamber according to AMCA 210/05 fig. 12  
 Free-field inlet side Lp(A) measurements at 1 m according to ISO 3746:2011

<b>Fan type:</b>	AXB 400	<b>Motor code suction:</b>	2120006	<b>Mot. ins. class:</b>	F
<b>Test nr.:</b>	51A – 51B	<b>Motor code blowing:</b>	2120007	<b>Motor T.H.:</b>	SW-ALARM
<b>Date:</b>	2022/06/20	<b>Motor power [W]:</b>	390	<b>Capacitor [<math>\mu</math>F]:</b>	-
<b>Power supply[V]:</b>	230 1~	<b>Rated speed[rpm]:</b>	1700	<b>Fan max. abs. current [A]:</b>	2,5
<b>Frequency [Hz]:</b>	50/60	<b>Mot. prot. class:</b>	IP44	<b>Noise [dB(A)]:</b>	68

**Fan ErP status: ErP 2015**

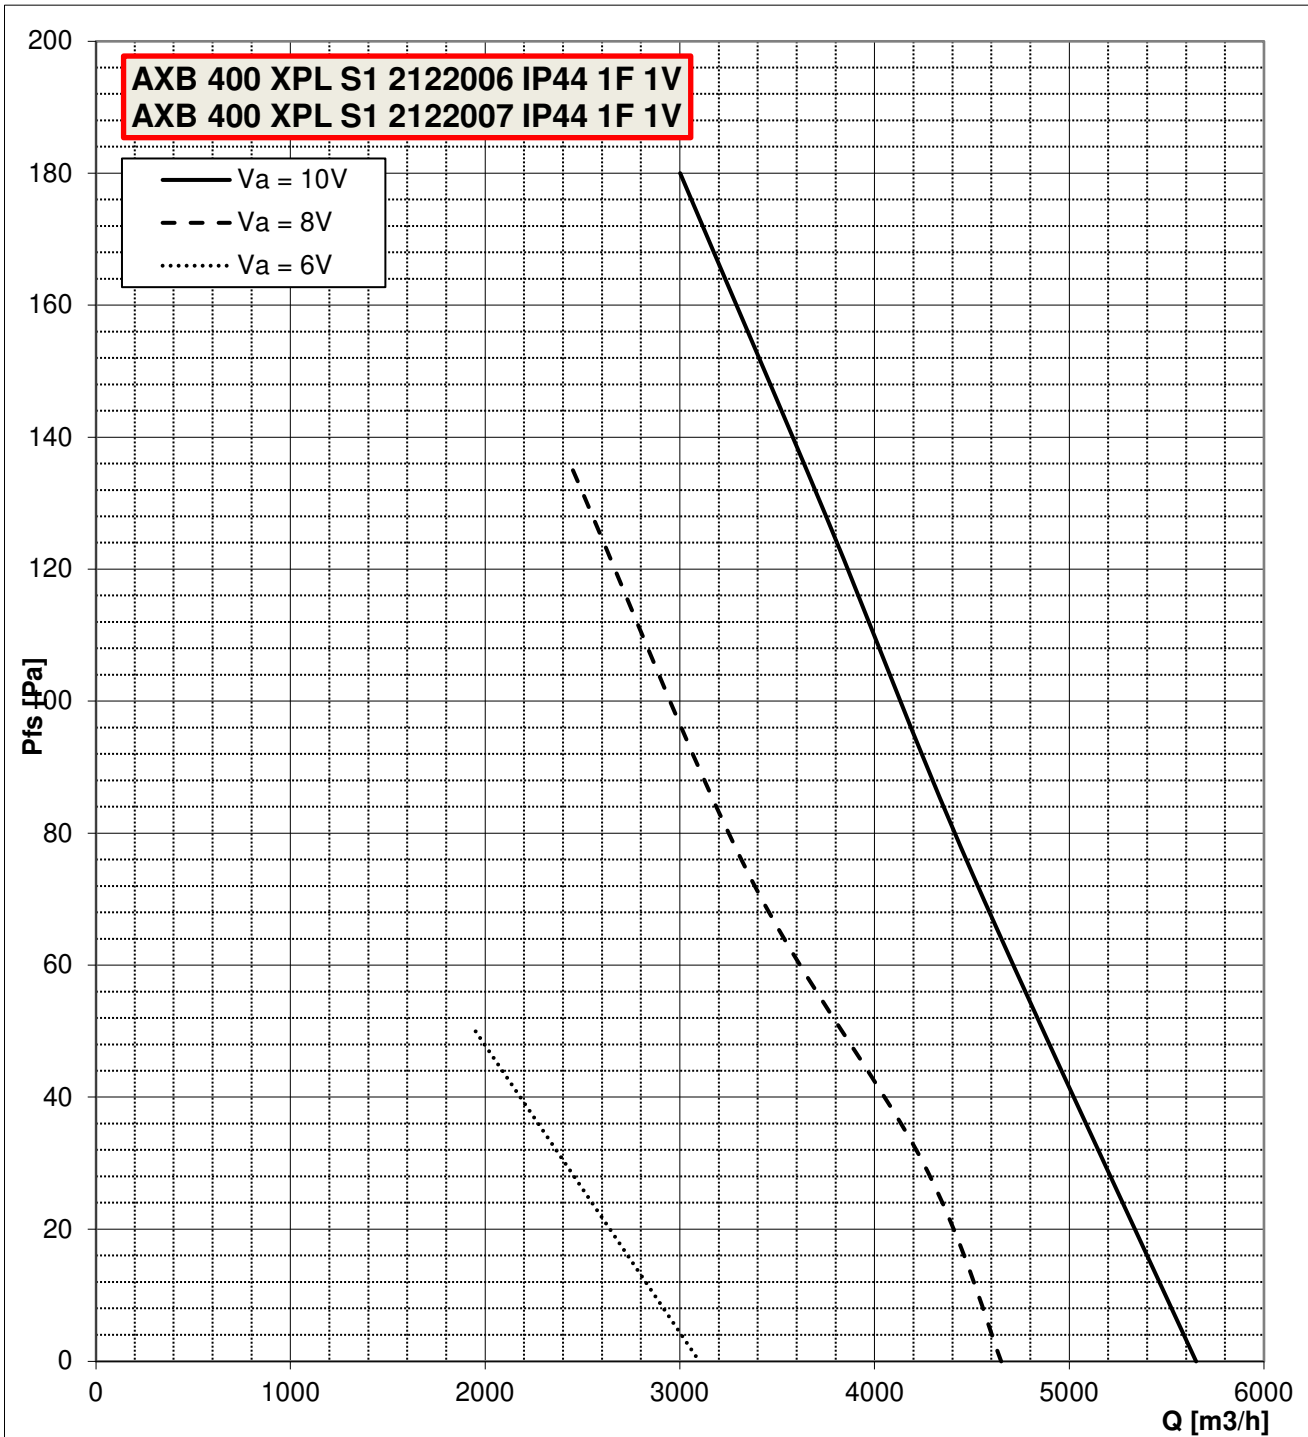

Data are not certified by AMCA